


Trial on Pro-biotics and aeration on Milk and Cheese factory waste water.

Test Date	BOD mg/l	TSS mg/l	COD mg/l	O & G mg/l
7/05/2007	16850	2750	23000	977
11/05/2007	8050	5200	14700	0
18/05/2007	9400	2250	14000	308
22/05/2007	2800	1850	6360	184
29/05/2007	780	1600	3700	36



Trial of Pro-biotics and aeration on Milk and Cheese Factory waste water

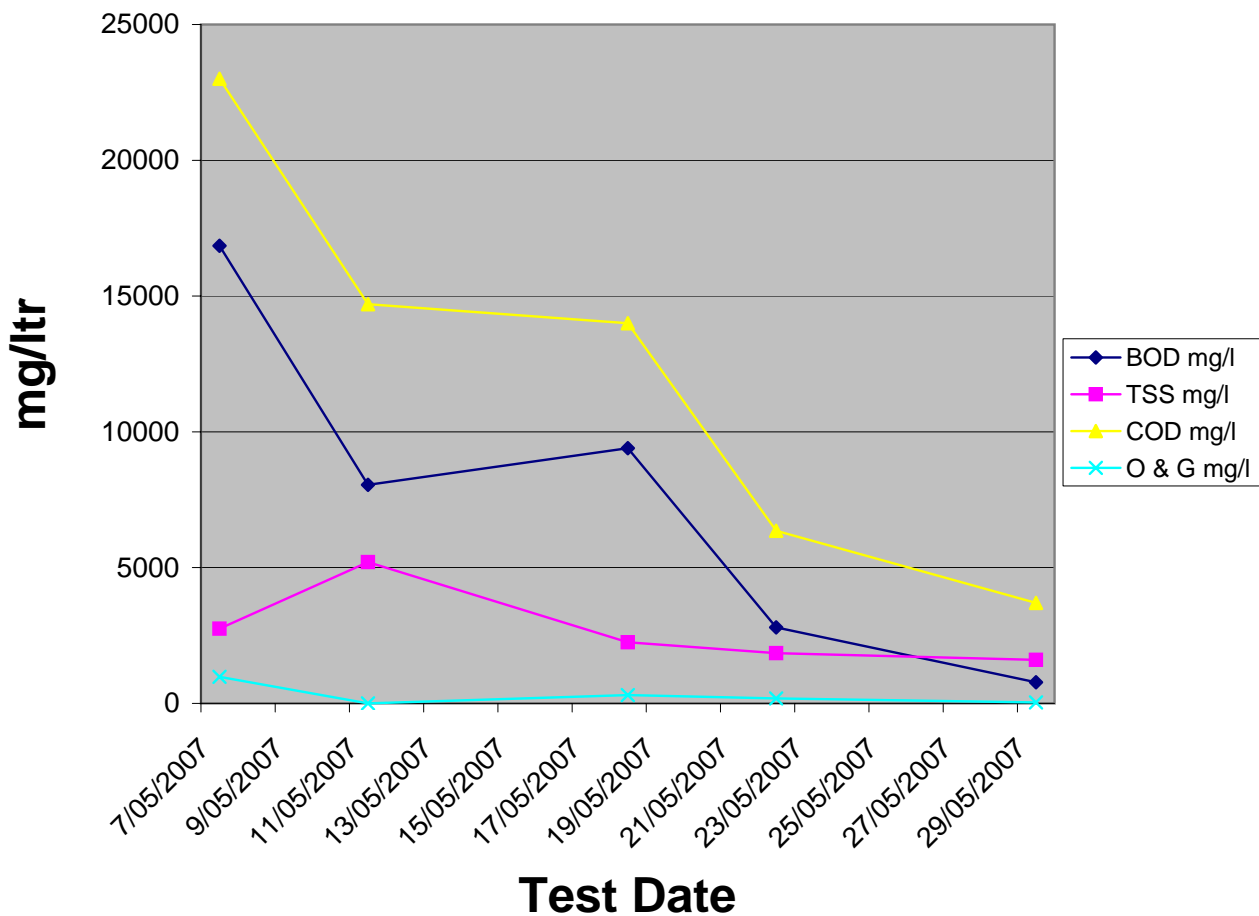

For further information please call 02 65814353